



PLAN VIEW

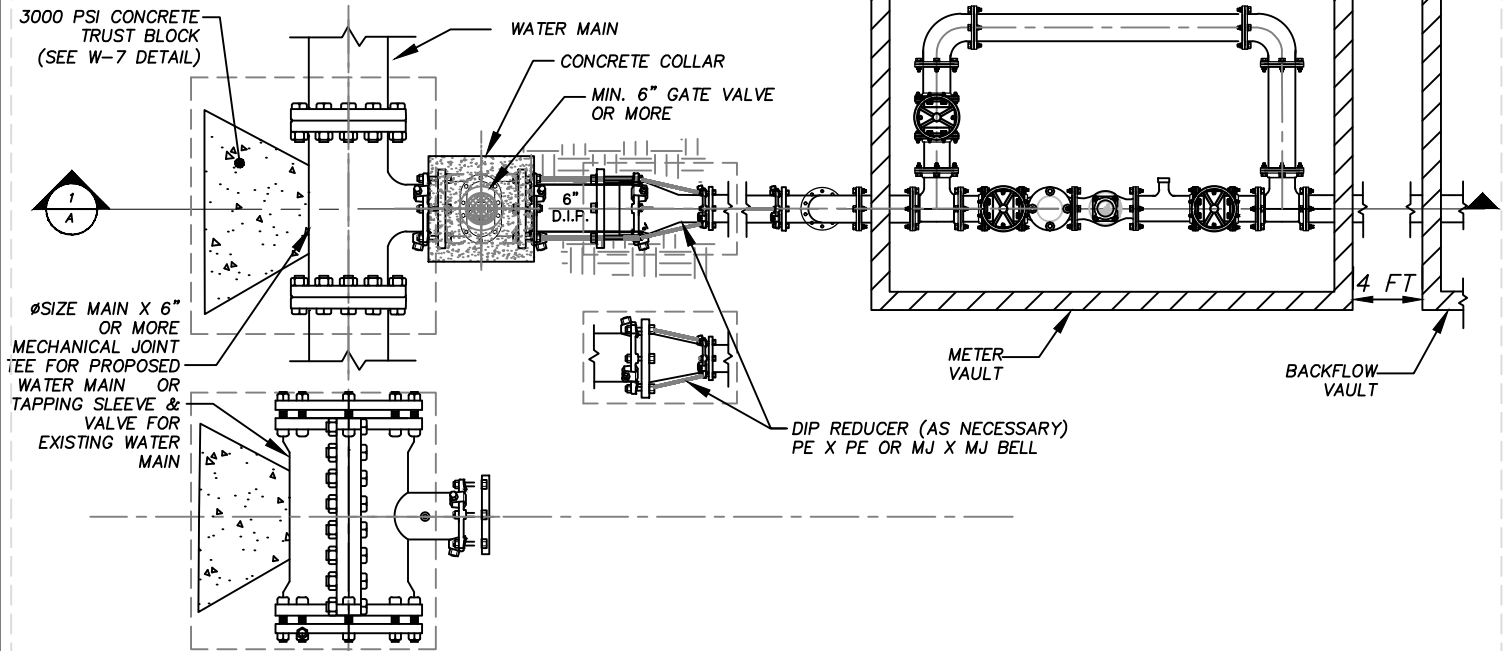

SECTION "A" VIEW

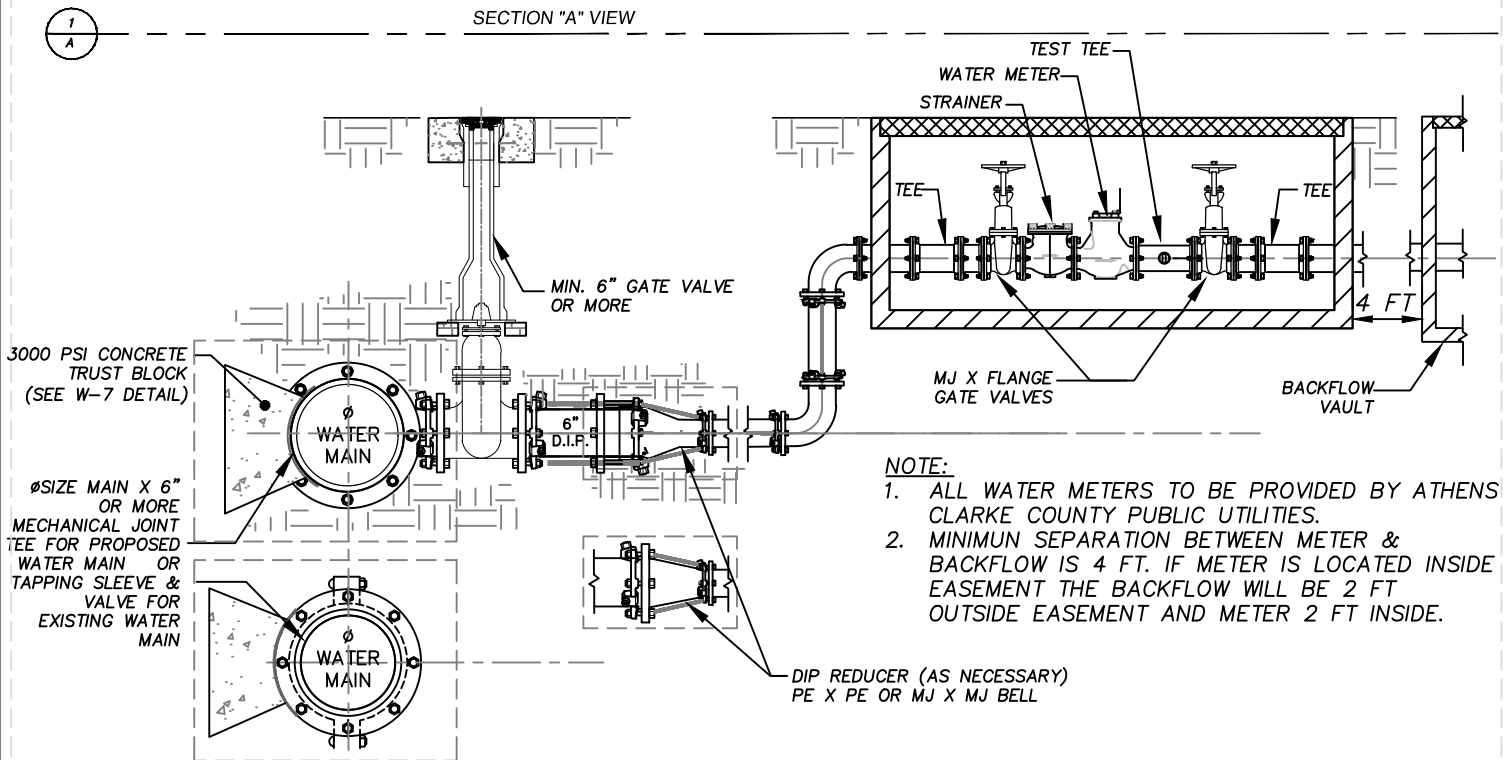

NOTE:

1. ALL WATER METERS TO BE PROVIDED BY ATHENS CLARKE COUNTY PUBLIC UTILITIES.
2. MINIMUM SEPARATION BETWEEN METER & BACKFLOW IS 4 FT. IF METER IS LOCATED INSIDE EASEMENT THE BACKFLOW WILL BE 2 FT OUTSIDE EASEMENT AND METER 2 FT INSIDE.

3" and Larger Water Service & Meter Connection

NTS

W-3A

Standard Specification and Detail for:

3" and Larger Water Service & Meter Connection

GMD: NA	County: Athens-Clarke	State: Georgia	Date: June, 2025
Drawn by: KFM	The Unified Government of Athens-Clarke County Department of Public Utilities 124 E Hancock Ave Athens, Georgia 30601 Fax: 706-613-3198 Voice: 706-613-3490		
Approved by: JH			
Scale: AS-SHOWN			

