



Notes:


1. Sidewalk must be the same thickness of the driveway (6' or 8') through the first full segment of sidewalk.
2. See Typical Intersection Detail 1-040 and 7-2-7(6) of Athens-Clarke County Code of Ordinances for driveway separation from intersections.
3. See 7-2-7(6) of the Athens-Clarke County Code of Ordinances for separation between driveways.




RECESSED CURB

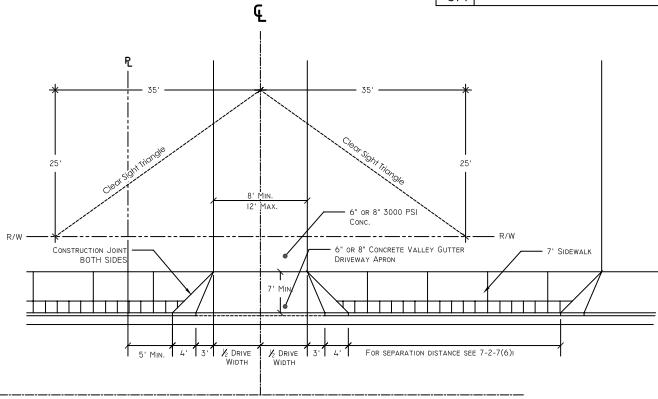

PLAN VIEW

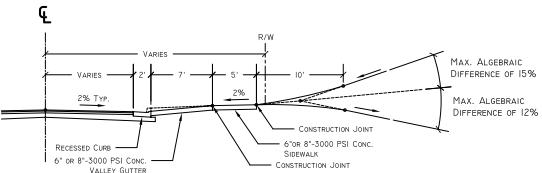


PROFILE VIEW

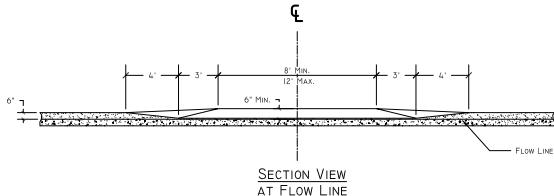


SECTION VIEW  
AT FLOW LINE

PLAN VIEW

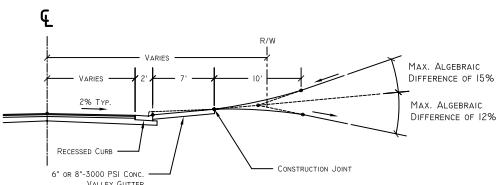

PROFILE VIEW

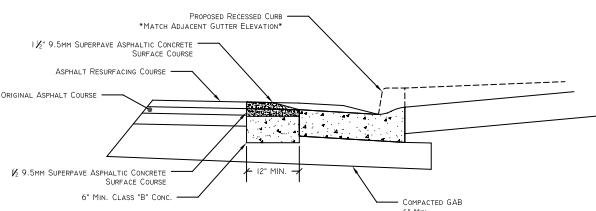

Notes:

1. For installation of curb and gutter along existing streets where excavated area with a width less than 5'.
2. Use typical section detail for excavated areas wider than 5'.
3. Graded Aggregate Base to be placed under curb at a minimum thickness of 6' and extend beyond the back of curb a minimum of 6'.

