



WHEN PIPE IS NOT UNDER PAVEMENT USE TYPE 1

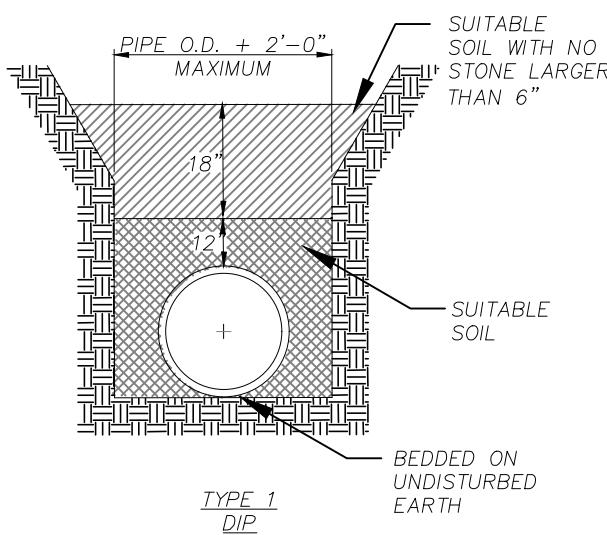

COMPACTED BACKFILL 95% OF THEORETICAL MAXIMUM DRY DENSITY WHEN UNDER PAVEMENT

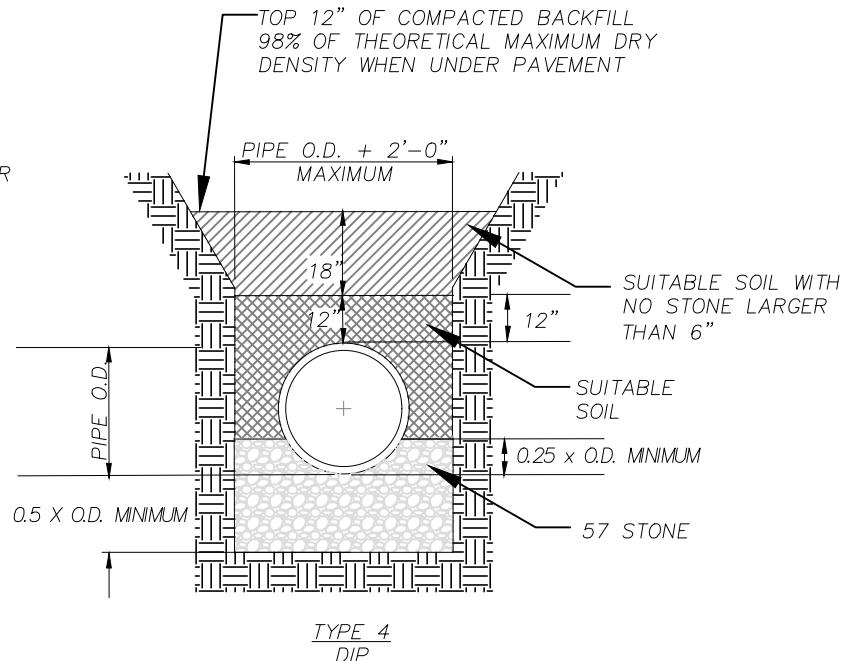

NOTE 1: IF TRENCH IS IN ROCK
TYPE 4 BEDDING IS REQUIRED

NOTE 2: 12" DIP AND LARGER THAT IS
DEEPER THAN 15' SHALL HAVE STONE UP
TO SPRING LINE.

Water Pipe Bedding Detail

NTS

W-14

Standard Specification and Detail for:

Water Pipe Bedding Detail

GMD: NA County: Athens-Clarke State: Georgia Date: October 28, 2025

Drawn by: KFM

Approved by: MRA

Scale: AS-SHOWN

The Unified Government of Athens-Clarke County
Department of Public Utilities

124 E Hancock Ave
Athens, Georgia 30601

Voice: 706-613-3490

