


PLAN VIEW

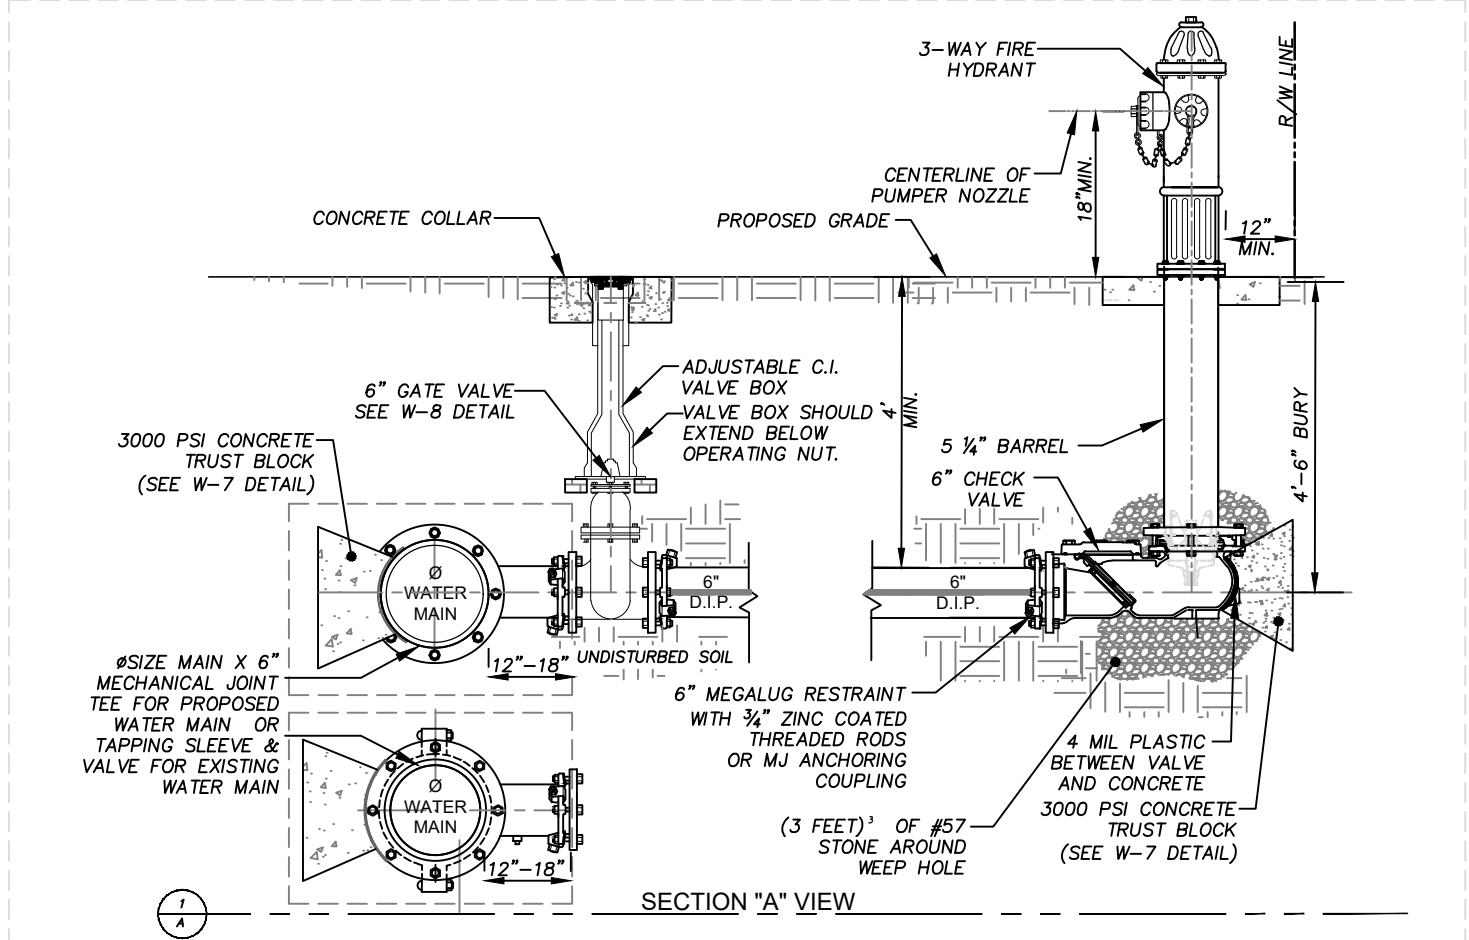

SECTION "A" VIEW

Fire Hydrant Assembled, 6" Check Valve, 6" DIP branch and 6" Gate Valve

NTS

W-2

Standard Specification and Detail for:

Fire Hydrant Assembled, 6" Check valve, 6" DIP branch and 6" Gate Valve

GMD: NA	County: Athens-Clarke	State: Georgia	Date: November, 2022
---------	-----------------------	----------------	----------------------

Drawn by:	KFM
Approved by:	MRA
Scale:	AS-SHOWN

The Unified Government of Athens-Clarke County
Department of Public Utilities
 124 E Hancock Ave
 Athens, Georgia 30601
 Fax: 706-613-3198
 Voice: 706-613-3490

