


PUMP STATION WET WELL PLAN VALVE MANHOLE

NOTE:
 JUNCTION BOX NO. 1 FOR PUMP POWER AND CONTROL CABLES.
 JUNCTION BOX NO. 2 FOR ANALOGUE CABLES FROM ULTRASONIC SENSOR AND COMBUSTIBLE GAS DETECTOR.

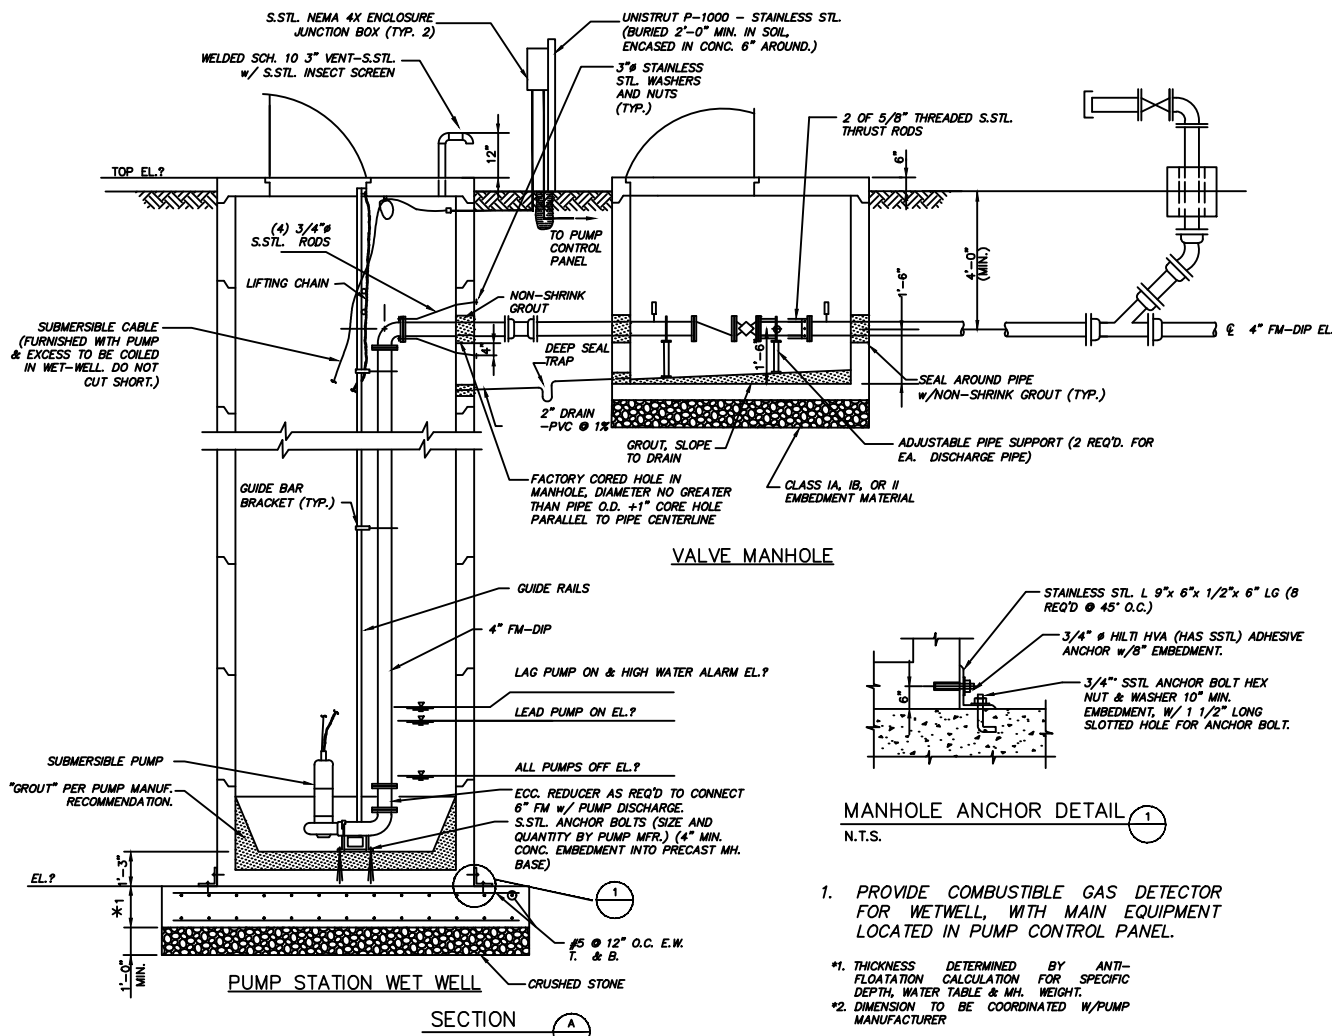

PUMP STATION WET WELL SECTION VALVE MANHOLE

MANHOLE ANCHOR DETAIL 1

1. PROVIDE COMBUSTIBLE GAS DETECTOR FOR WETWELL, WITH MAIN EQUIPMENT LOCATED IN PUMP CONTROL PANEL.

*1. THICKNESS DETERMINED BY ANTI-FLOATATION CALCULATION FOR SPECIFIC DEPTH, WATER TABLE & MH. WEIGHT.
 *2. DIMENSION TO BE COORDINATED W/PUMP MANUFACTURER

Pump Station (6' diameter wetwell)

NTS

PS-1

Standard Specification and Detail for:

Pumping Station (6' diameter wetwell)

GMD: NA	County: Athens-Clarke	State: Georgia	Date: August, 2019
Drawn by: KFM	The Unified Government of Athens-Clarke County Department of Public Utilities 124 E Hancock Ave Athens, Georgia 30601 Fax: 706-613-3198 Voice: 706-613-3490		
Approved by: GJ			
Scale: AS-SHOWN			

