W-15 DEAD END FIRE HYDRANT.dwg

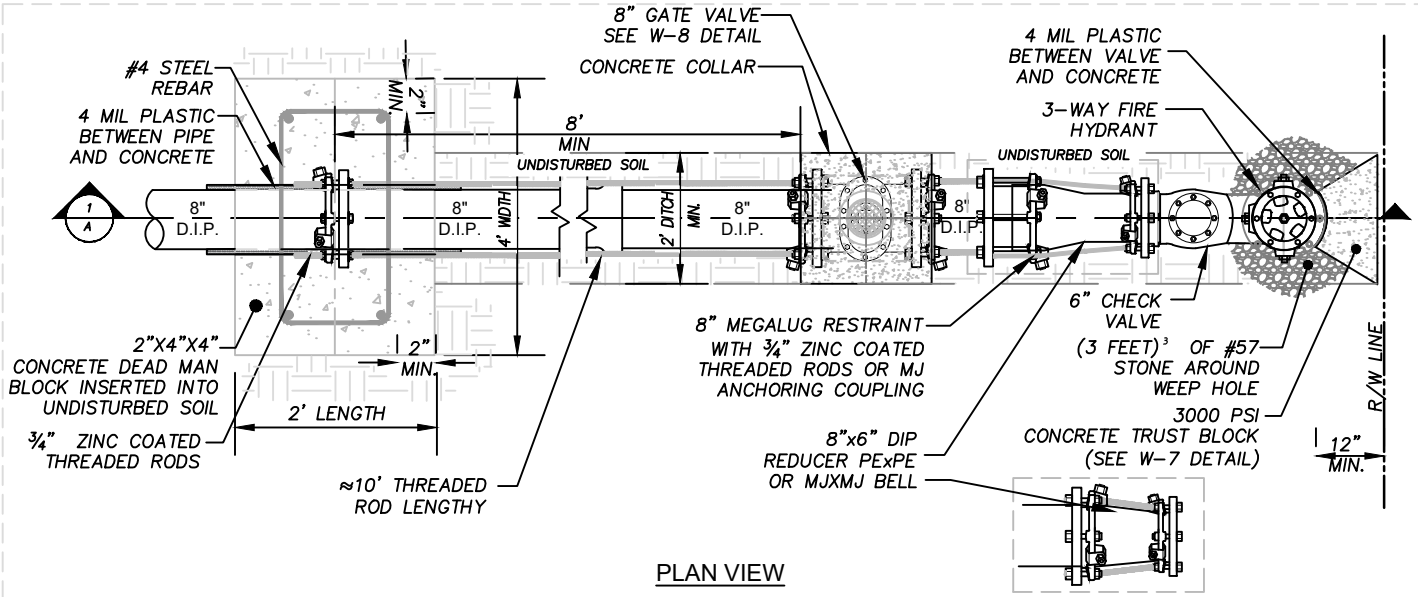

PLAN VIEW

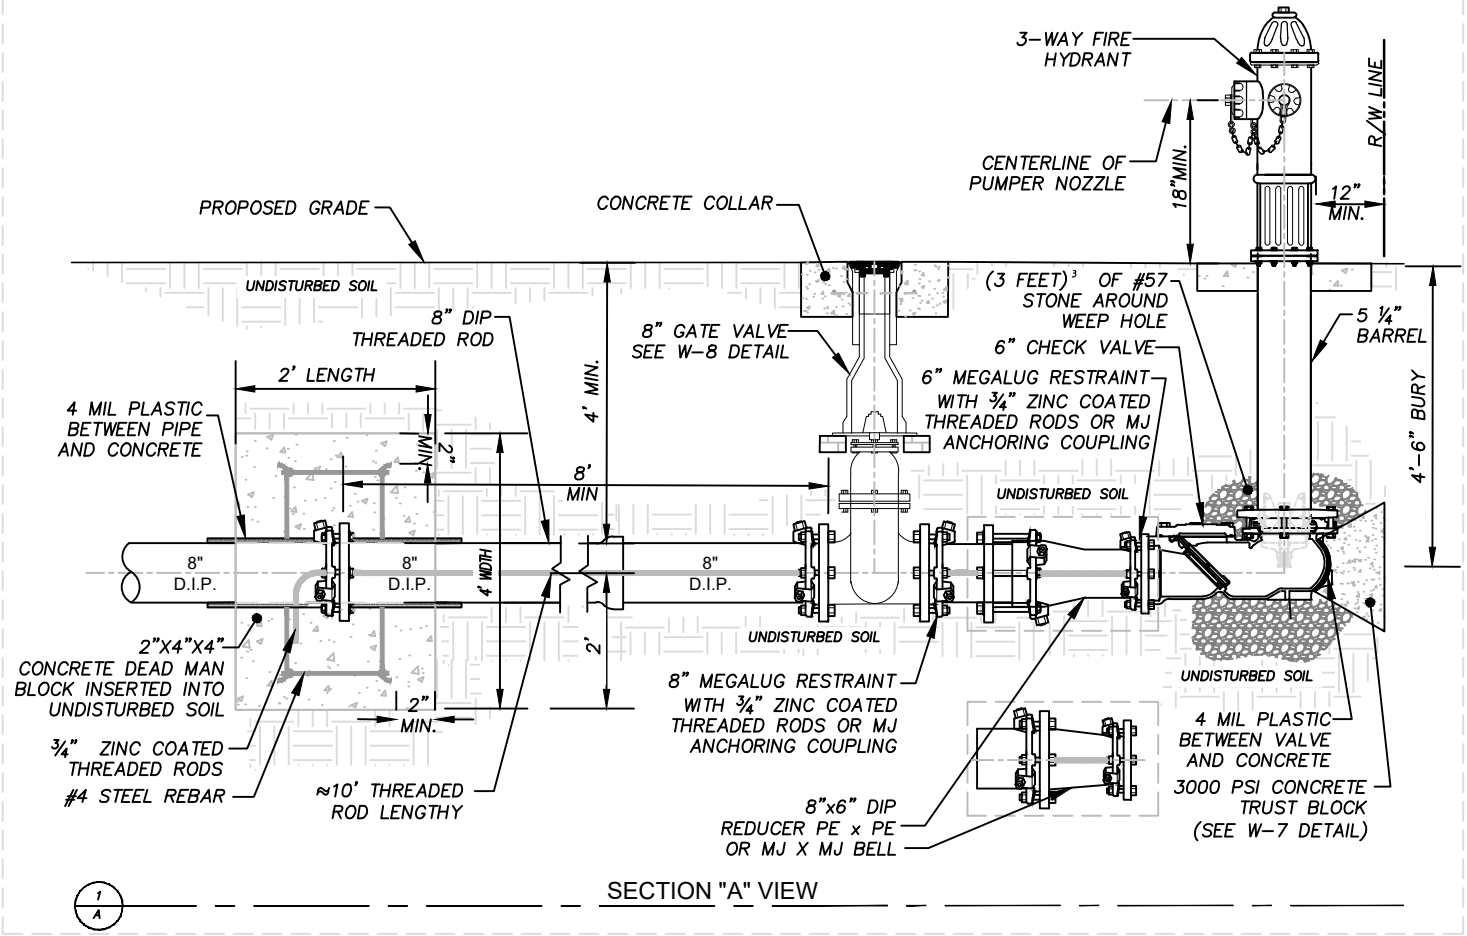

1/A SECTION "A" VIEW

Dead End Fire Hydrant Assembled

NTS

W-15

Standard Specification and Detail for:

Dead End Fire Hydrant w/ Gate Valve

GMD: NA	County: Athens-Clarke	State: Georgia	Date: November, 2022
Drawn by: KFM			
Approved by: MRA			
Scale: AS-SHOWN			

The Unified Government of Athens-Clarke County
Department of Public Utilities
124 E Hancock Ave
Athens, Georgia 30601
Fax: 706-613-3198
Voice: 706-613-3490